

THAI CONST & BUILDING MANUFACTURING PUBLIC COMPANY LIMITED
NO.120 MOO 1, SOI MOHBANG, SUKSAWAD ROAD, LAEMFAHPA, PHRASAMUTCHEDI
SAMUTPRAKAN 10290 THAILAND
TEL (+662) 815-3600 FAX (+662) 815-2850

The following sample(s) was/ were submitted and identified on behalf of the client as:

Sample Name : SCAFFOLD PUTLOG COUPLER
Sample Number : SHCCM140400818
Test Required : Slipping force
Test method : With reference to BS 1139-2.2:2009 and client's requirement
Product specification : 48.3mm
Material and Mark : Q235
Date of Receipt : Apr. 24, 2014
Test Period : Apr. 24, 2014 to Apr. 30, 2014
Test result(s) : For further details, please refer to the following page(s)
***** To be continued*****

Signed for SGS-CSTC Standards
Technical Services (Shanghai) Co., Ltd.


Vivien Zhang
Authorized signatory

TCB

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

SHCCM 007221

Test Conducted: With reference to BS 1139-2.2:2009 Metal scaffolding – Part 2: Couplers – Section 2.2: Aluminium couplers and special couplers in steel – Requirements and test methods and client's requirement

Test Result:


Test item	Specimens	P _{max} (kN)	Client's requirement	Conclusion
Slipping force	No.1	2.261	>1.25 kN	Pass
	No.2	2.493		
	No.3	2.087		
	No.4	2.289		
	No.5	2.164		

Statement: Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

Test photo:



Sample photo

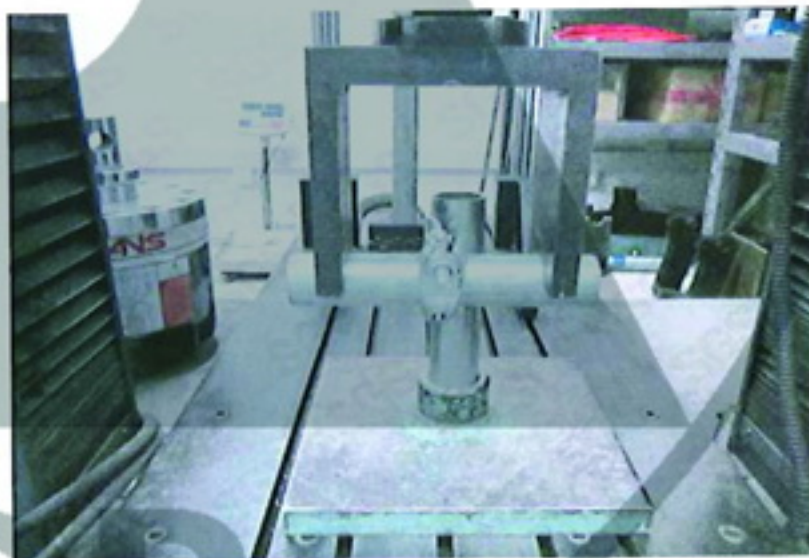

Test arrangement

***** End of report *****

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

SHCCM 007222